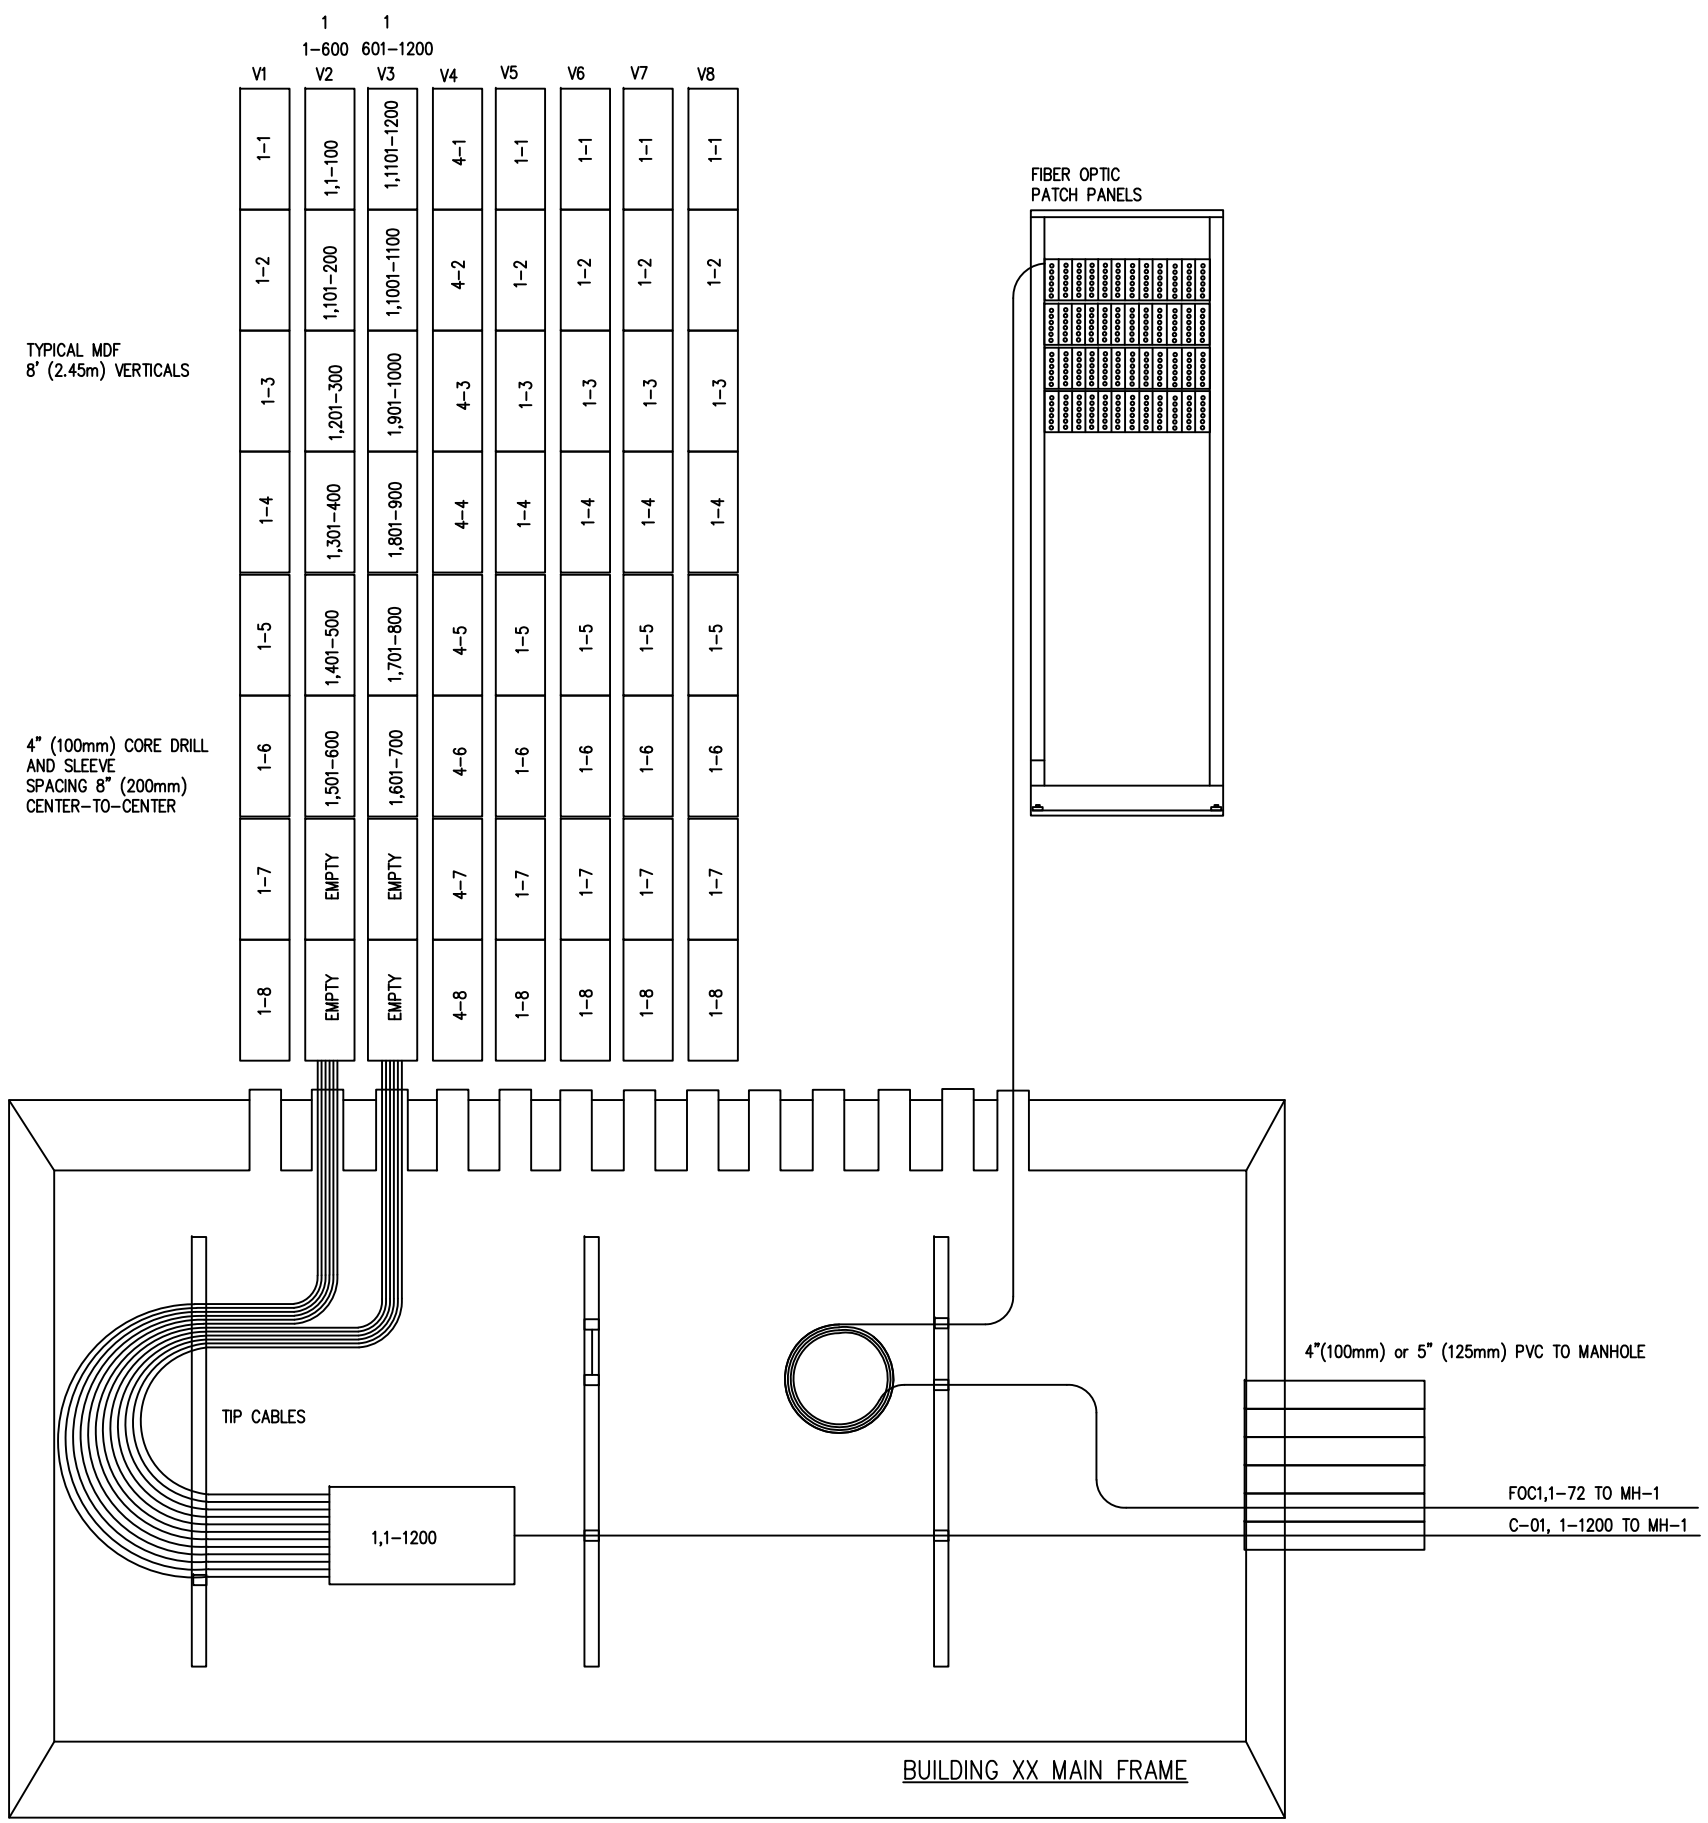


NOTES:

1. FOC SHALL BE TERMINATED WITHIN 50 FEET OF BUILDING PENETRATION OR EXTENDED IAW NFPA 70 NATIONAL ELECTRIC CODE REQUIREMENTS. USE OF OTHER CABLE TYPES THAT MEET NFPA 70 REQUIREMENTS MAY BE USED TO EXTEND THE TERMINATION FURTHER INTO THE BUILDING (E.G. INDOOR/OUTDOOR RATED CABLE). THE MAIN TERMINATION POINT WILL HOUSE THE FOPPS AND SERVE AS THE FACILITIES DEMARCATION POINT WHERE THE OSP CABLING TRANSITIONS TO ISP CABLING