NOTES:
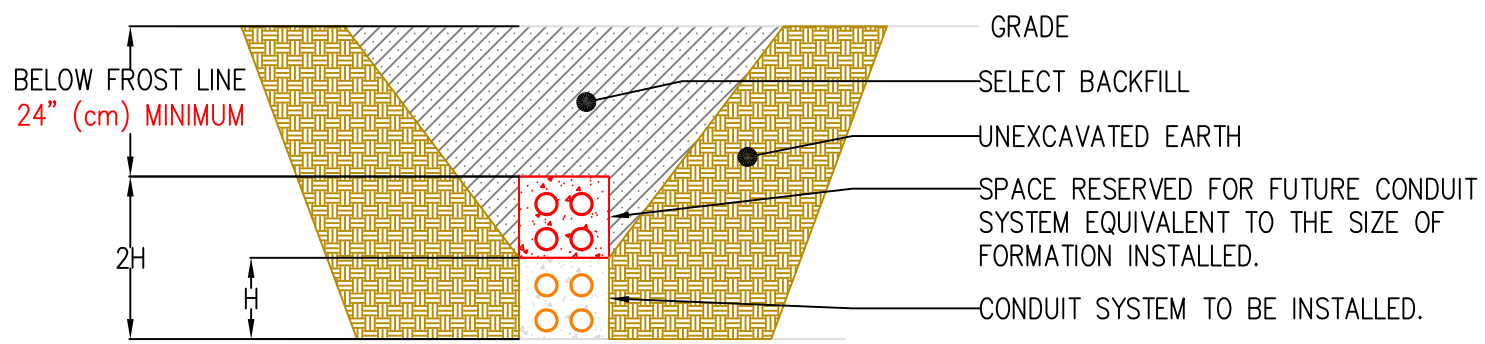
1. THE FOLLOWING CRITERIA MUST BE FOLLOWED WHEN DETERMINING THE TRENCH DEPTH FOR NEW CONDUIT SYSTEMS:
   - 1.1. THE HEIGHT OF THE CONDUIT FORMATION TO PLACED MUST BE DOUBLED. THE DOUBLING ALLOWS FOR FUTURE CONDUIT SYSTEMS OF AN EQUIVALENT SIZE TO BE PLACED OVER THE INITIALLY PLACED SYSTEM.
   - 1.2. THIS OVERALL HEIGHT OF COMBINED CONDUIT FORMATIONS MUST BE PLACED AT A DEPTH BELOW THE FROST LINE AND NOT LESS THAN 24' (60 cm).