


## **NOTES:**

- 1. FOR DETAILS OF CABLE RACKS, DUCT ENTRANCE AND PULLING-IN IRONS, SEE PLATE UG-7.
- 2. MINIMUM CONCRETE COMPRESSIVE STRENGTH SHALL BE 21 MPa.

	MANHOLE DIMENSIONS					
TYPE	Α	В	C (AT HIGH PT.)			
1	1800	1800	2000			
5	1800	2500	2000			


STANDARD ELECTRICAL MANHOLE (NONTRAFFIC)
TYPES 1 & 2


SKETCH DATE JUNE 2002 STYLE  $\bigcup G-1$ 

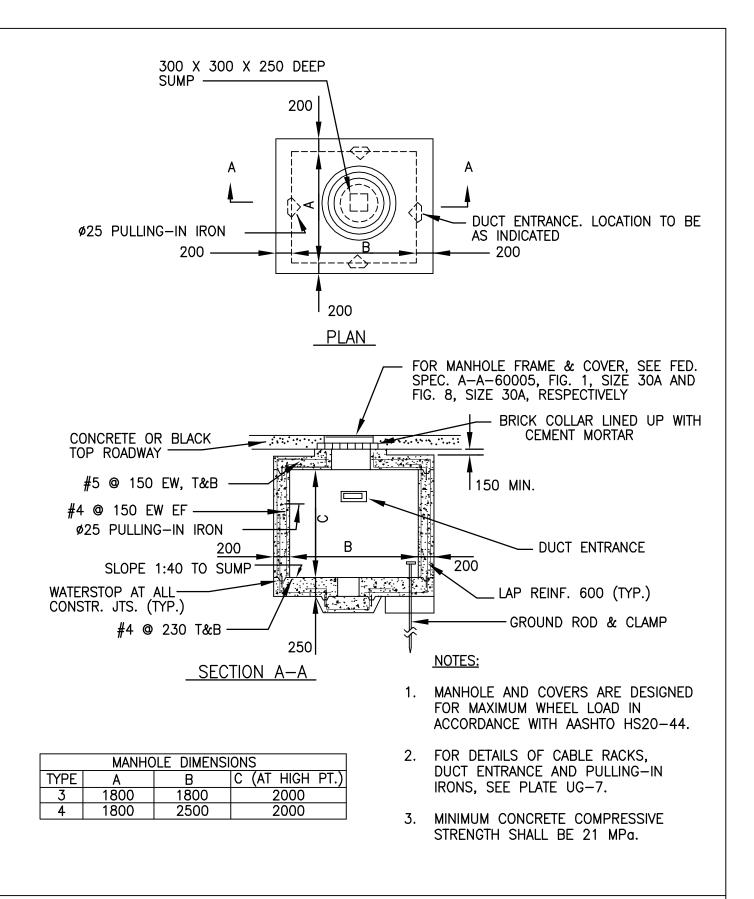

STANDARD	ELECTRICAL	MANHOLE	(TRAFFIC)
	TYPES 3		,

SKETCH DATE JUNE 2002 STYLE UG-2

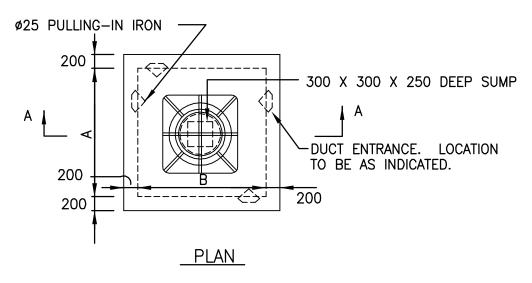

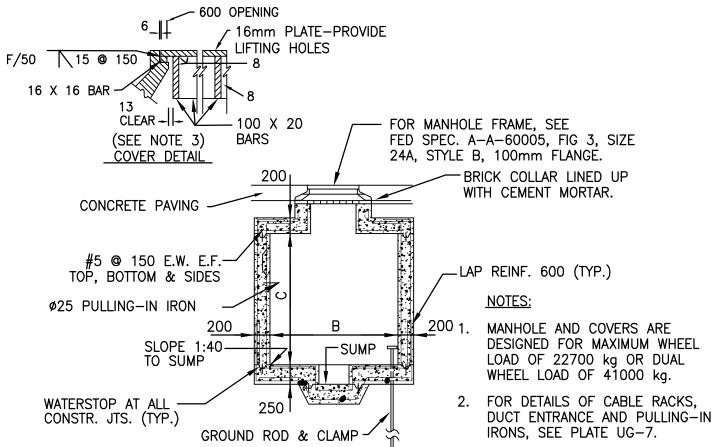

SECTION A-A

 MANHOLE DIMENSIONS

 A
 B
 C (AT HIGH PT.)

 1800
 1800
 2000

 1800
 2500
 2000

TYPE

5

6


4. MINIMUM CONCRETE COMPRESSIVE STRENGTH SHALL BE 21 MPa.

COVER SHALL BE MADE OF STRUCTURAL STEEL CONFORMING

TO ASTM A 36/A 36M.


STANDARD ELECTRICAL MANHOLE (AIRFIELD)
TYPES 5 & 6

SKETCH DATE JUNE 2002 STYLE UG-3

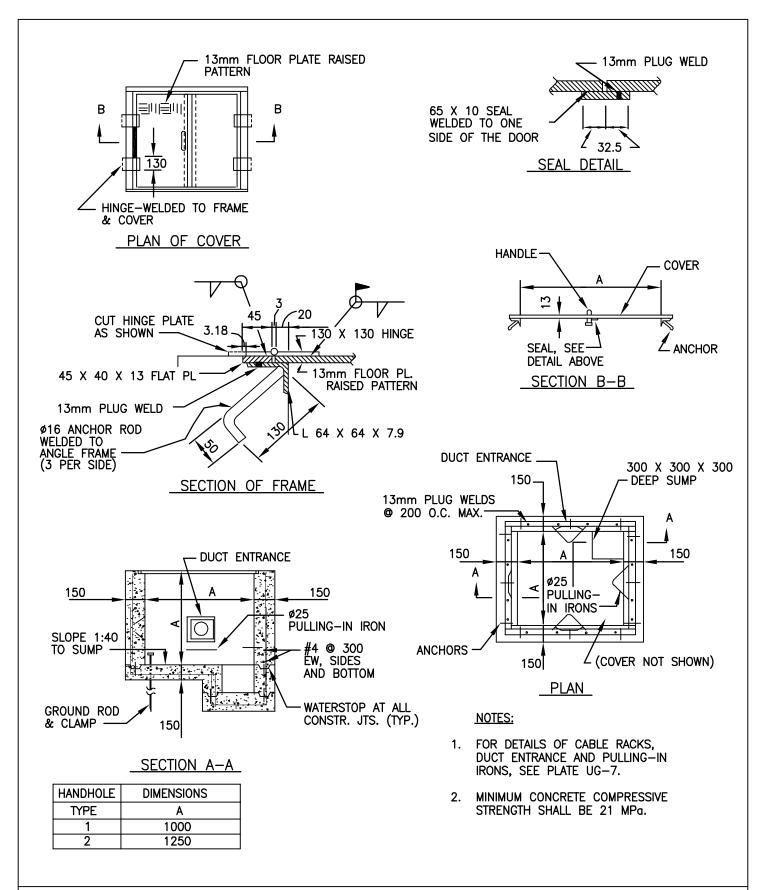


STANDARD ELECTRICAL HANDHOLE (NONTRAFFIC)
TYPES 1 & 2

SKETCH DATE JUNE 2002 STYLE  $\bigcup G-4$ 

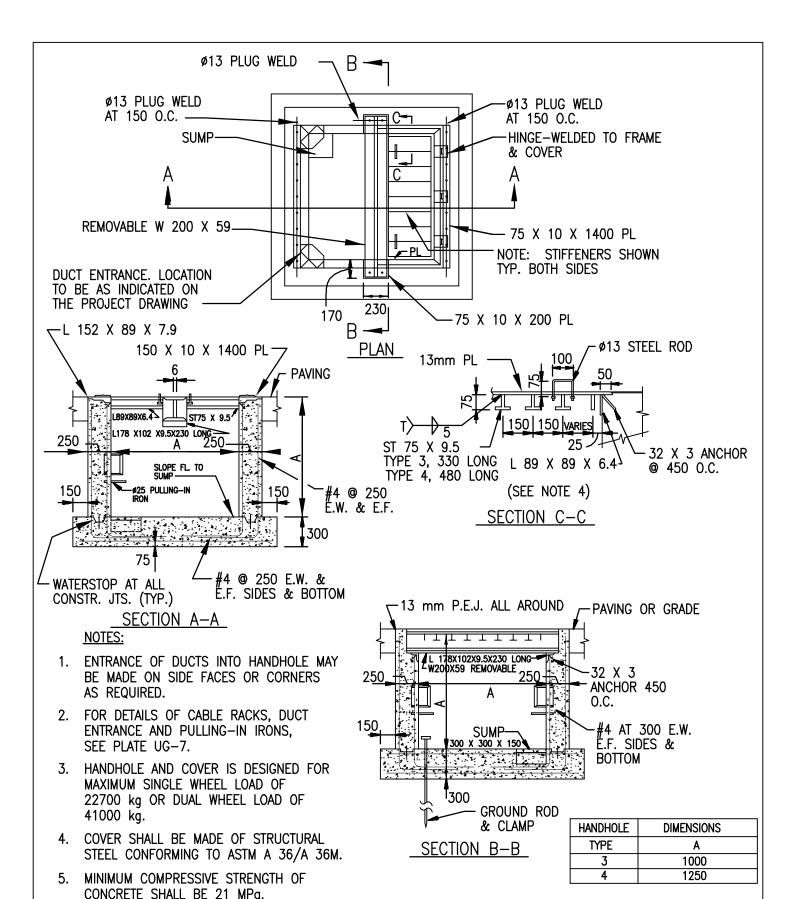

STANDARD ELECTRICAL HANDHOLE (TRAFFIC/AIRFIELD)
TYPES 3 & 4


SKETCH DATE JUNE 2002 | STYLE UG-5

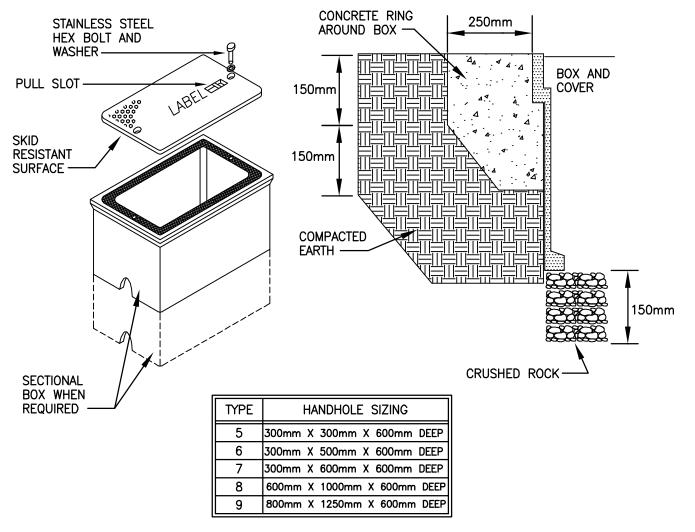


## HANDHOLE REQUIREMENTS

- 1. HOUSING SHALL BE A POLYMER CONCRETE REINFORCED WITH A HEAVY WEAVE FIBERGLASS REINFORCING WITH COMPRESSIVE STRENGTH OF NO LESS THAN 70 MPa.
- 2. COVER AND BOX SHALL WITHSTAND A SERVICE LOAD OF NO LESS THAN 6800 kg OVER A 250  $\times$  250 AREA.
- 3. PROVIDE STAINLESS STEEL BOLTS AND INSERTS.
- 4. PROVIDE WITH (2) 64mm MOUSEHOLES.
- 5. PROVIDE LABEL "ELECTRICAL" FOR POWER HANDHOLES OR "TELEPHONE" FOR TELEPHONE HANDHOLES, OR <u>AS INDICATED.</u>

STANDARD ELECTRICAL HANDHOLE (NONTRAFFIC) (COMPOSITE/FIBERGLASS) TYPES 5, 6, 7, 8 & 9

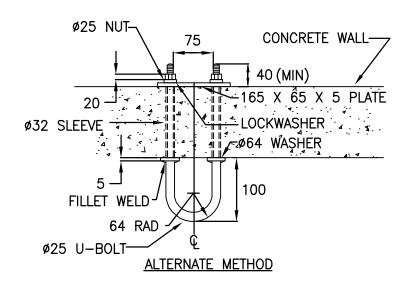





CAST IN PLACE

NOTE ALL METAL PARTS SHALL BE HOT DIP GALVANIZED

## DETAIL OF PULLING-IN IRON



## TYPICAL CABLE RACK

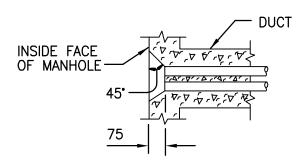

TYPICAL DUCT ENTRANCE

DETAILS (PULLING-IN IRONS, CABLE RACK AND DUCT ENTRANCE)

SKETCH DATE JUNE 2002 STYLE UG-7